




SILVERTAG SHOWER

TAG SIGNATURE
219 E Washington Street
Lewisburg, WV 24901
(304) 536-1982
(304) 647-3523 fax
www.tagsignature.com

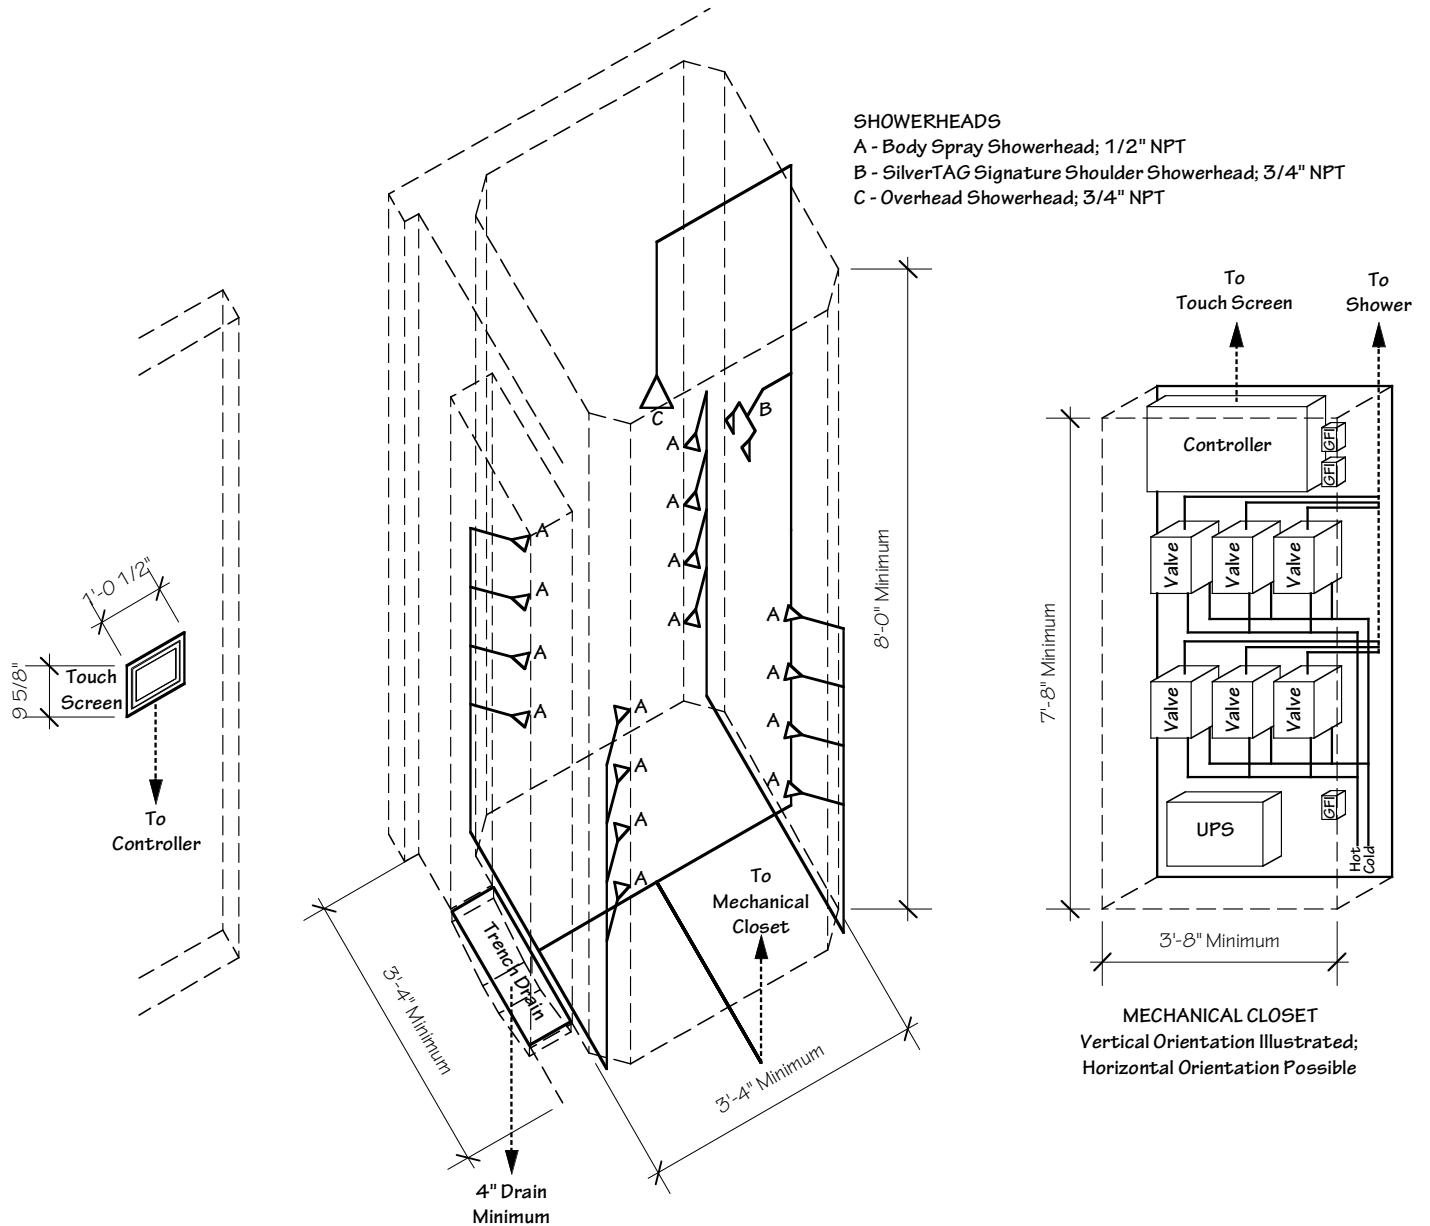

FEATURES

- 18 Showerheads; 6 Zones
- Each Zone has independent control of Temperature and Pressure
- Custom Therapeutic Shower Sequences (eight total)
- SilverTAG Signature Shoulder Showerhead
- Touchscreen Interface

WATER SUPPLY REQUIREMENTS

- 275 gallons of water is used in a 5 minute sequence
- Maximum water flow at any one time is 67 GPM at 65 PSI
- 1 1/2" hot and cold water lines recommended
- Maximum Sequence Temperature is 110 degrees; Minimum Sequence Temperature is 70 degrees
- Assuming 130 degree hot water and 65 degree cold water; A sequence uses approximately 55% hot and 45 % cold

DRAINAGE REQUIREMENT

Drain is to be able to clear 65 GPM quickly and cleanly without back up

VENTILATION REQUIREMENT

Ventilation is required to remove moisture from the shower area

WATER PROOFING OF SHOWER AREA

The SilverTAG Shower is a high water volume shower that requires complete water proofing of the shower area

ELECTRICAL REQUIREMENT

A 115 volt/ 15 amp circuit located in the Mechanical Closet

CUSTOMIZATION

The above illustrations are guidelines. Our Design and Engineering Team customizes each SilverTAG Shower for every installation.